


# INSTA STIK™ Quik Set Pull Test Results



Pre-Job Qualification Form No.: \_\_\_\_\_ Date of Pull Test: \_\_\_\_\_  
Job Name: \_\_\_\_\_ City: \_\_\_\_\_ State/Province: \_\_\_\_\_  
Roof Deck Area in Squares: \_\_\_\_\_ Air Temperature (°F): \_\_\_\_\_  
Substrate Material: \_\_\_\_\_ Coating/Primer: \_\_\_\_\_  
Board/Insulation\*: \_\_\_\_\_ Thickness: \_\_\_\_\_

## Circle Test Area Used:

### INSTA STIK™ Test Area/Bead Spacing for Pull Test

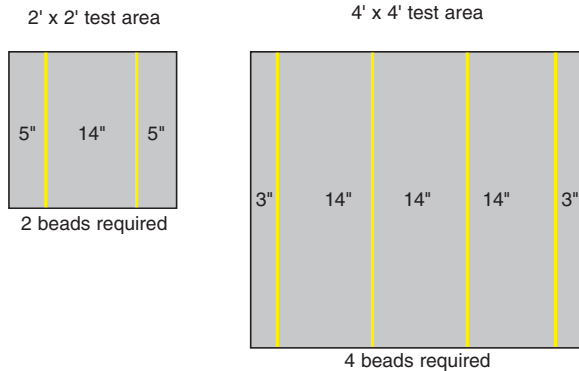

## Two pull tests are required for roof decks < 500 squares:

TEST #1: PASS \_\_\_\_\_ FAIL \_\_\_\_\_ FAILURE MODE: \_\_\_\_\_

TEST #2: PASS \_\_\_\_\_ FAIL \_\_\_\_\_ FAILURE MODE: \_\_\_\_\_

## Three pull tests are required for roof decks 500 to 1,000 squares; 4 tests if > 1,000 squares:

TEST #3: PASS \_\_\_\_\_ FAIL \_\_\_\_\_ FAILURE MODE: \_\_\_\_\_

TEST #4: PASS \_\_\_\_\_ FAIL \_\_\_\_\_ FAILURE MODE: \_\_\_\_\_

## Authorized INSTA STIK™ Quik Set representative who performed the pull test:

Signature: \_\_\_\_\_ Date: \_\_\_\_\_

Print Name: \_\_\_\_\_

Return completed form to:

**Dow Building Solutions**

**Attn: Julie Foye**

**1605 Joseph Drive**

**200 Larkin Center**

**Midland, MI 48674**

**E: JAFoye@dow.com**

**P: 1-989-636-8181**

**F: 1-989-636-6912**

**www.dowadhesives.com**

**Technical Information**

1-866-583-BLUE (2583) (English)

1-800-363-6210 (French)

**Sales Information**

1-800-232-2436 (English)

1-800-565-1255 (French)

**IN THE U.S.**

THE DOW CHEMICAL COMPANY

200 Larkin

Midland, MI 48674

**IN CANADA**

DOW CHEMICAL CANADA ULC

450 – 1st St. SW . Suite 2100

Calgary, AB T2P 5H1